

ATI-5020 Probe Configuration



A.T.Monitors Order ID #: _____
 Customer: _____
 PO #: _____, Quantity: _____

Dimensions

Probe dimensions are in inches, cm.

NOTE: Total probe tube length = **A+B** or **A+B+C**.
 If these total more than 130", an extension tube will be added to the probe to retain explosion-proof certification.

- [A]- Out-of-tank Length = _____ (minimum 8" / 20.3cm)
- [B]- In-tank Length = _____ (must be less than tank depth)
- [C]- (if applicable) Height of riser pipe above tank = _____

E to H: Refer to page 2 to select probe configuration.

Minimum distance between switch points = 3" (7.6 cm).

- [D]- Minimum 2" / 5cm (from level [H] to bottom of probe)
- [E]- Highest alarm level switch point = _____
- [F]- Mid-High alarm level switch point = _____
- [G]- Mid-Low alarm level switch point = _____
- [H]- Lowest (or single) alarm level switch point = _____
- [J]- NPT reducer fitting = 2" (standard), 1-1/2"
 or Other (please specify) _____

The reducer fitting will be screwed into Tank, Riser pipe

Product in Tank


- Diesel, Gasoline, Waste oil, Water,
- Other (please specify) _____

Customer Approval

Print name: _____

Signature: _____

Date: _____ (mm/dd/yyyy)

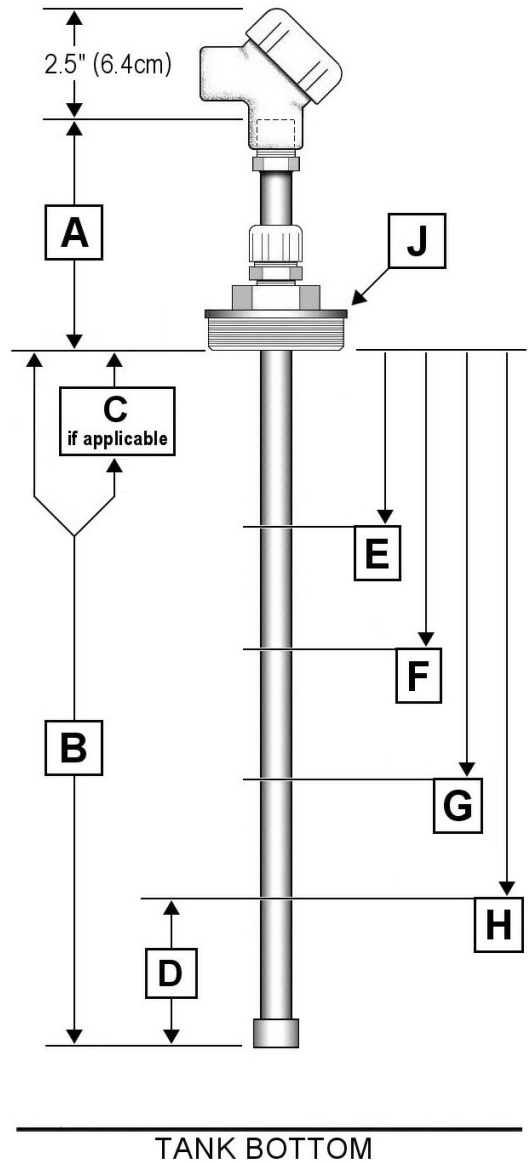

For office use only

ATI-5020 Probe
 Serial #: _____

Monitor (optional)
 Model #: _____
 Serial #: _____

ATI-5020 Probe Configuration Selection

NOTE: All reed switches are Normally Open. Arrows indicate float direction to CLOSE each switch.

A.T.Monitors Order ID #: _____

Customer: _____, PO #: _____

